
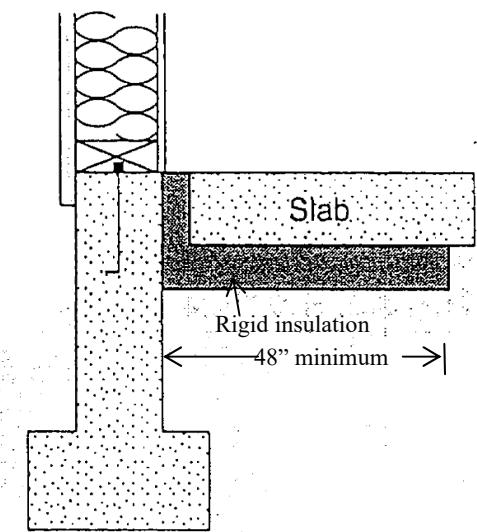
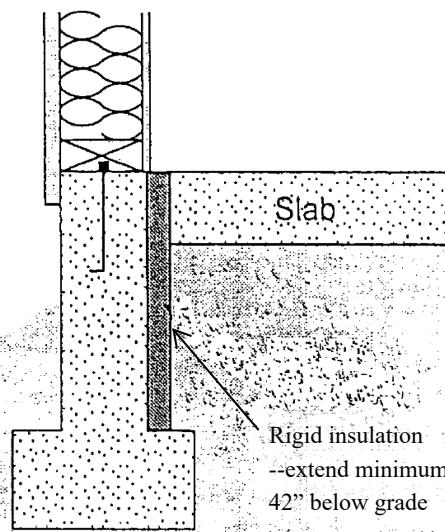
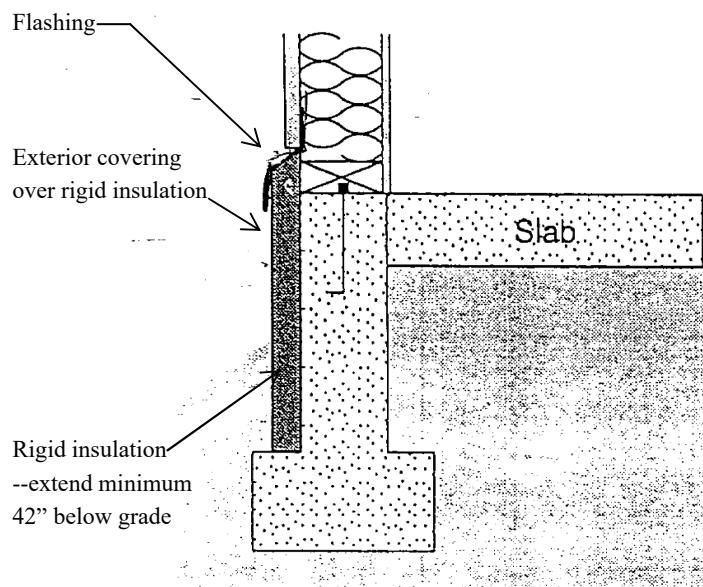


# SLAB EDGE INSULATION METHODS

NOTE: ALL RIGID INSULATION REQUIRED  
TO BE A MINIMUM OF R-10

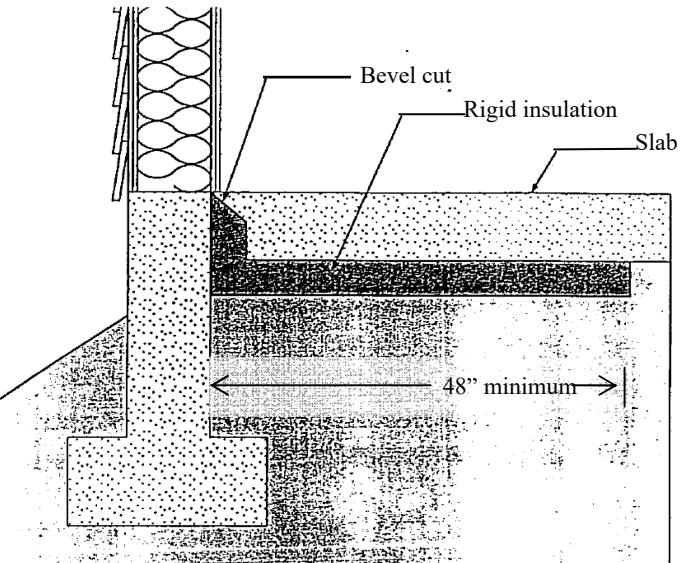

NOTE: Minimum footing depth 42" from top  
of grade to bottom of footing